

## mark130      DDC controllers



### Summary

DDC (Direct digital control) controller mark130 is free programmable process station with ARM Cortex M4 processor and OS FreeRTOS. It is suitable for control of small installation or use like control panel for other mark process station with Merbon runtime. Mark130 contains 1x Ethernet port, 1x RS485 interface, 1x RS232 interface and external 8 MB RAM.

### Application

- Control panel incl. mark process station with Merbon runtime for HVAC systems or other technologies
- Free programmable control units for small HVAC systems and other applications

### Function

The controller hosts an embedded FreeRTOS operating system which boots up the Merbon runtime with the application. The board contains real time clock with battery backup, flash memory containing OS, runtime, application, and other data (time programs, setpoints etc.), and a watchdog. It is also possible to use NVRAM to backup parameters in case of unexpected system shutdown.

The application is created and uploaded in the Merbon IDE development environment. The maximum application program size depends on number of physical and software data points, amount of function blocks which require more memory (e.g. time schedulers), degree of code optimisation, and number of connections the PLC has to handle.

For communication with other devices, mark130 contains 1x Ethernet port, 1x a RS485 interface and 1x a RS232 interface.

The process station contains a web server for remote connection and user intervention. The web pages and LDC menu are created and uploaded to the process station through Merbon IDE. From the security point of view, the website is not

recommended for use in the public network, it is intended for operation in a local network. Therefore it is necessary to integrate the configured router or other element that ensures network security during the design of the network topology.

The process station can be operated through a 4 x 20 characters backlit LCD display and 6 pushbuttons. Users move in the menu using buttons – the **active row is the second row** from the top, which is enhanced by the red line on the printed cover. Objects such as Value setting, Alarm, and Time schedule have predefined functionality, and thus for the configuration it is only necessary to set addresses, assign data points, and complete user texts.

The user menu structure is configured and uploaded to the process station through Merbon IDE (see LCD menu definition in PLC properties).

The device is installed using three plastic clamps into an aperture in panel door or any suitable box. The aperture dimensions are 153 x 100 mm, with tolerance 2 mm.


## Technical data

---

Power	24 V AC/DC ± 20%; max. 5 VA
<b>Communication</b>	
Ethernet	1x Ethernet 10/100BaseT RJ45, 2 LED (link, data) integrated in the connector
RS232	COM2 1x CANNON 9 male; pin 2=TX, 3=RX, 5=GND galvanically insulated, insulating voltage 1 kV 300 ... 115 200 bit/s, parity and bits are set in SW
RS485	COM1 RS485 (K+, K-) galvanically insulated, insulating voltage 1 kV 300 ... 115 200 bit/s, parity and bits are set in SW maximal bus length 1200 m maximum number of modules depends on requested response time – up to 255 addresses, for common HVAC applications use about 300...400 physical data points on the bus
LCD display	4 rows x 20 characters, blue backlight possibility to switch off the backlight through application software
Buttons	6 buttons on a membrane keyboard, water and dirt resistant
4x LED	PWR, RUN, RS485 TxD/RxD
HW	ARM Cortex M4 168 MHz, 10 MB FLASH, 256 KB SRAM, 64 KB NVRAM, 8 MB external SDRAM
SW	Merbon IDE (supported from version ER 2.4.0.14)

Housing	Polycarbonate (PC) box (UL94V-2); front panel polyester membrane keypad
Front panel dimensions	171.8 x 116.5 x 39.3 mm; see scheme below
Aperture dimensions	153 x 100 mm (deviation +2 mm)
Front protection degree	IP65 (EN 60529 + A2:2019)
Terminals	screw terminals M3, recommended wire diameter 0,35 - 1,5 mm <sup>2</sup>
Ambient temperature	From +5 to +40 °C; from 5 to 85 % relative humidity; non-condensing gases and chemically non-aggressive conditions (according EN 60721-3-3 ed.2. climatic class 3K22) (from the front see Front protection degree)
Standards of conformity	EMC EN IEC 61000-6-2 ed.4:2019, EN IEC 61000-6-4 ed.3:2019 EN IEC 62368-1 ed.2:2020+A11:2020 EN IEC 63000:2019

## Terminals

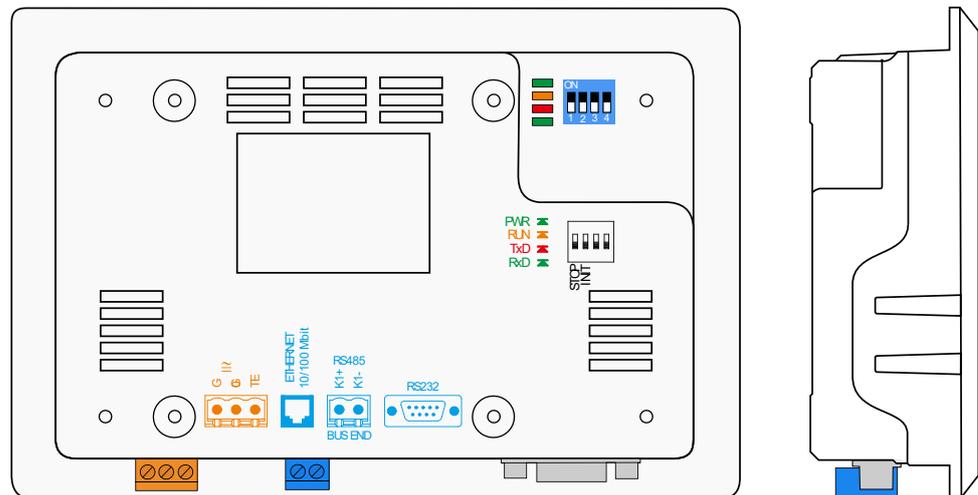

### Terminals and connectors:


<b>G</b>	power
<b>G0</b>	power
<b>TE</b>	optional connection for shielding
<b>Ethernet</b>	network interface
<b>RS232</b>	port COM2 - serial link RS232; CANNON 9 male
<b>RS485</b>	port COM1 - serial link RS485, terminals K+, K-

### LED indication:

<b>PWR</b>	green LED – power (ON: power OK; OFF: no power applied, weak or damaged power supply, ...)
<b>RUN</b>	orange LED – system cycle (OK: LED flashes periodically 1 s ON, 1 s OFF; ERROR: LED flashes in other pattern, LED is still ON or OFF)
<b>TxD</b>	red LED – RS485 transmitting data at COM1 (flashing: transmitting data; OFF: no data traffic)

- RxD** green LED – RS485 receiving data at COM1 (flashing: receiving data; OFF: no data traffic)
- DIP switches:**
- STOP** DIP1 if ON runtime is running, program execution is stopped
- INIT** DIP2 if ON at power-up, configuration parameters are brought to defaults (see Configuration parameters in Merbon IDE; for example IP address, user and password, database settings, proxy, ...)
- BUS END** If ON = bus end COM1; the first and last devices on bus should have bus end ON; switch is under the RS485 terminals

## Dimensions

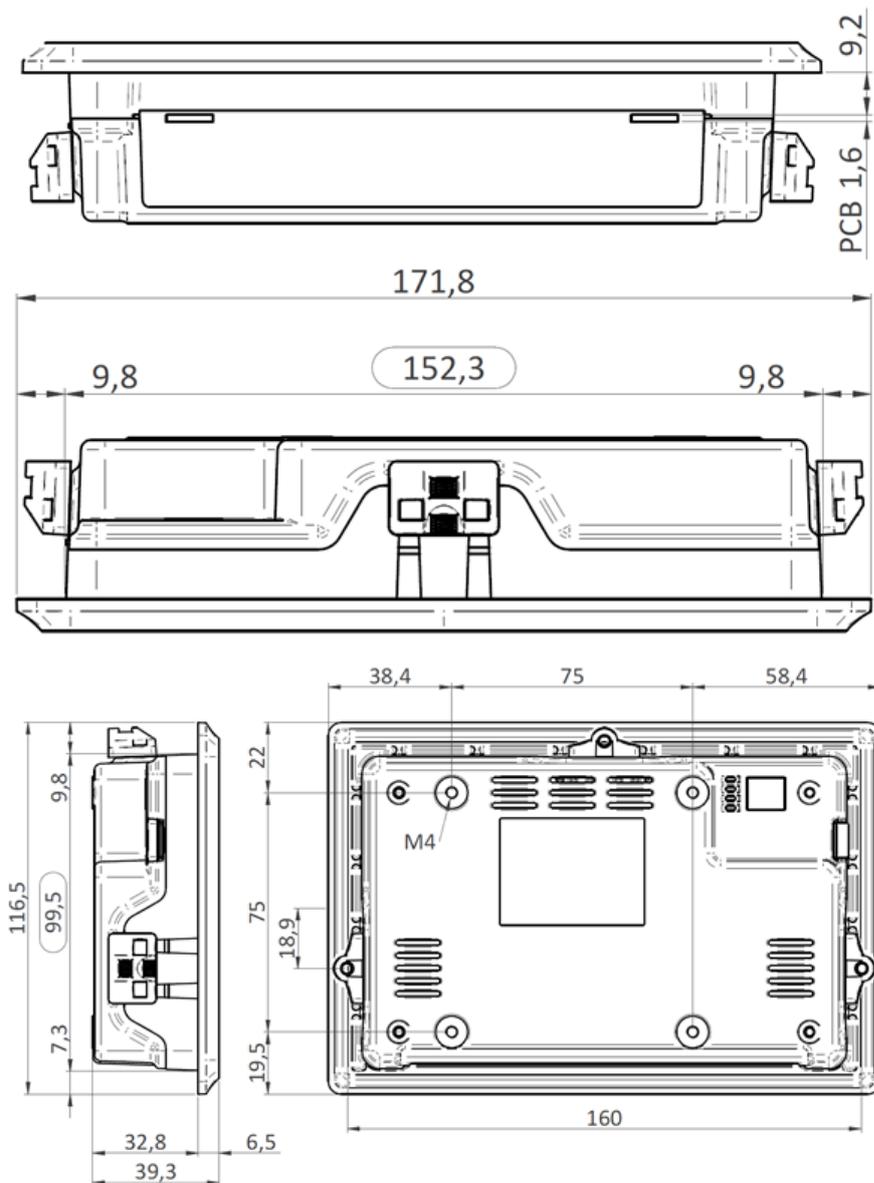

Dimensions are in *mm*.

## Programming **Merbon IDE**

The main programming tool is the Merbon package which contains I/O editor, graphical editor of the function plan (FBD), structure text editor, compiler, LCD menu editor as well as web editor (Merbon IDE).

The application program consists of function blocks which are stored in libraries. Those contain analogue and digital functions, mathematical blocks including goniometric functions, time schedulers, alarm blocks, and HVAC specific blocks (heat recovery, dewpoint calculation, enthalpy, pump switch etc.).

The minimum guaranteed number of records for history on the PLC is 79 000, but the actual number of stored samples may be larger depending on the data types that are stored in the history. The program can be set up also as structure text (ST) or with combination of both types of programming languages.

## Communication Default network settings are:

IP address	192.168.1.10
subnet mask	255.255.255.0
default gateway	192.168.1.1

SSCP user: admin  
Password: rw

Notice: Do not forget to note the new network settings after change!

After these values have been changed, it is possible to bring the process station into default settings by the INIT DIP switch: set INIT to ON and restart the station. All values in the PLC configuration are set to defaults. The PLC will respond at the default IP address and it is possible to change the old address through Merbon IDE.

The controllers can share variables over the Ethernet network (outside temperature, heat demands etc.) together with other PLC platforms.

The runtime provides drivers for communication with I/O modules and other subsystems. For example Merbon runtime contains: Modbus TCP / RTU (server/client), M-Bus, IEC62056-21, SSCP, SoftPLC link and BACnet IP server/client (viz PICS). The complete list of drivers can be found in the Channel configuration dialogue in the most recent Merbon release. Please check the required protocol features and functions with the list of implemented features in the Merbon IDE help. It is also possible to program own communication drivers using the I/O library functions in structure text language.

**Number of communication channels** (on the serial lines and Ethernet) to I/O modules and subsystems is not directly restricted. It depends on available RAM PLC memory.

**Number of connections from SSCP clients is max. 5.** This includes connections from RcWare Vision, Merbon IDE, HT102/200, mobile application Merbon Menu Reader, connection from other PLCs over SSCP etc.

**Number of connections from Modbus TCP clients on Modbus TCP server is max. 5.** Other clients channels (web, ...) are not directly restricted.

**RoHS notice**

The device contains a non-rechargeable battery which backups the real-time clock and part of the memory. After the device is not operable, please return it to the manufacturer or dispose of it in compliance with local regulations.

**Safety note**

The device is designed for monitoring and control of heating, ventilation, and air conditioning systems. It must not be used for protection of persons against health risks or death, as a safety element, or in applications where its failure could lead to physical or property damage or environmental damage. All risks related to device operation must be considered together with design, installation, and operation of the entire control system which the device is part of.

**Changes in  
versions**

02/2021 – First version of datasheet.

03/2021 – Correction of DIP switch description, change of the logo.